

SITOR FUSE-LINK UTILIZ. CATEGORY GS, DIN 43620 40A , AC 690 V ,(SIZE 000)



Figure similar

Model		
product brand name		SETRON
Design of an identification indicator		front indicator
Design of the fuse link		SITOR, LV HRC design
General technical data		
Size of fuse system / acc. to DIN EN 60269-1		NH000
Operating class of the fuse link		gS
circuit-breaker / Design		3NE
Varying load factor (WL)		1
Supply voltage / at DC	V	250
Switching capacity		
Switching capacity current		
• acc. to IEC 60947-2 / rated value	kA	100
Dissipation		
Power loss [W]		
• for rated value of the current / at AC / in hot operating state / per pole	W	5
• maximum	W	5

## Electricity

rated current I <sub>n</sub> / IEC, DIN/VDE / at 40 Cel	A	40
Current / at AC / rated value	A	40

## Mechanical Design

Mounting position		Any, preferably vertical
-------------------	--	--------------------------

## Environmental conditions

<b>Ambient temperature</b>		
• minimum	°C	-20
• maximum	°C	50
<b>Environmental category</b>		-20 to +50 at 95% relative humidity

## Certificates

<b>Equipment marking</b>		
• acc. to DIN EN 61346-2		F
• acc. to DIN EN 81346-2		F

<b>General Product Approval</b>	<b>Declaration of Conformity</b>	<b>other</b>
---------------------------------	----------------------------------	--------------



[sonstig](#)

## Further information

### Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/lowvoltage/catalogs>

### Industry Mall (Online ordering system)

<https://eb.automation.siemens.com/mall/en/WW/Catalog/Product/3NE18020>

### Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<http://support.automation.siemens.com/WW/view/en/3NE18020/all>

### Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)


[http://www.automation.siemens.com/bilddb/cax\\_en.aspx?mlfb=3NE18020](http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3NE18020)

### CAX-Online-Generator

<http://www.siemens.com/cax>

### Tender specifications

<http://ausschreibungstexte.siemens.com/tiplv>

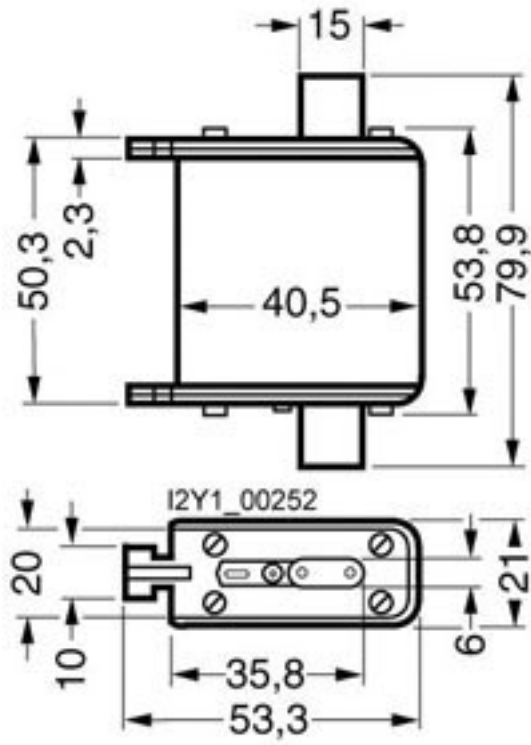

last modified:

12.04.2016